

QG series

QG76 analog H-series

QG76-SD-010H-AV-CM-UL

Inclination sensor

2 axis horizontal mounting

Factory programmable device

Output: 0,5 - 4,5 V

Measuring range programmable

between $\pm 1^\circ$ and $\pm 10^\circ$

Measuring range

Factory defaults: $\pm 10^\circ$



General specifications 12398, v20230412

Stainless steel (AISI 316)

70x60x33 mm

Not Included: 4x M4x30 mm stainless steel (A4) Hexagon socket head screws

IP67, IP69K (with IP69K mating connector), (IP68 with optional cable gland)

0 - 95% (non condensing, housing fully potted)

approx. 700 gram

8 - 30 V dc

Yes

≤ 25 mA

$-40 \dots +80^\circ\text{C}$

$-40 \dots +85^\circ\text{C}$

Factory defaults: $\pm 10^\circ$

Yes ($2,5\text{ V} = 0^\circ$), range: $\pm 5^\circ$

0 - 10 Hz

$0,04^\circ$ typ.

$\pm 0,02^\circ$ typ. ($\pm 0,05^\circ 2\sigma$) after centering

$\pm 0,04^\circ$ typ., $\pm 0,07^\circ 2\sigma$, $\pm 0,09^\circ$ max.

not applicable. Repeatability $0,05^\circ$

$0,01^\circ$

$\pm 0,005^\circ/\text{K}$ typ.

20.000g

0,5 - 4,5 V

$R_{load} \geq 20\text{k}\Omega$, $C_{load} \leq 20\text{ nF}$

Yes (max 10 s)


20 ms

Factory programmable (measuring range, filtering)

$$U_{out} = 2,5 + 2 \cdot (\alpha/10) [V]$$

clipping outside measuring range

Transfer characteristic

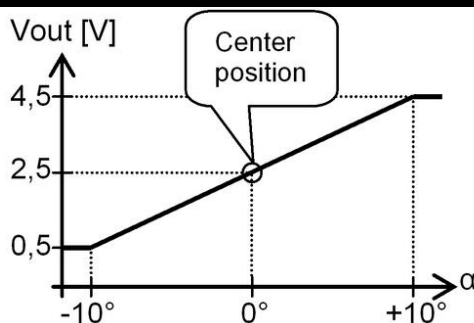


Default 0°: horizontal (top upwards),
no acceleration applied.

Cross tilt sensitivity error:
< $(0,12 \cdot \text{cross tilt angle})^2$ % typ.

→ one axis <10° tilt for max.
accuracy


Measurement orientation

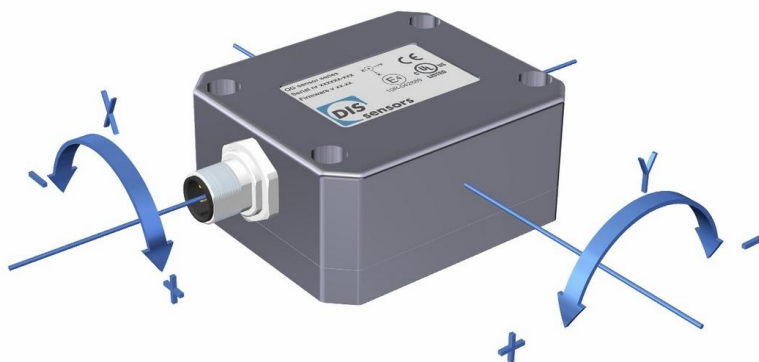

Connectivity (cable length ±10%)

M12 male 8p connector (stainless steel 1.4404 (316L), contacts copper alloy)


- | | |
|--------|----------------------|
| Pin 1: | Output Y |
| Pin 2: | Supply voltage |
| Pin 3: | for factory use only |
| Pin 4: | for factory use only |
| Pin 5: | Gnd |
| Pin 6: | Centering input |
| Pin 7: | Output X |
| Pin 8: | Not connected |



Connection

Wire / pin coding

Mechanical dimensions (indicative only)

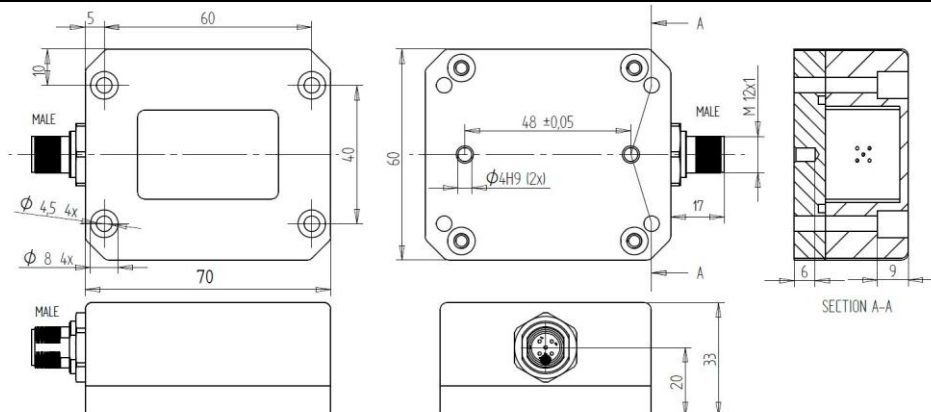

Center function, intended use & UL

Centering can be done to eliminate mechanical offsets. To execute centering connect center input to ground ($>0,5\text{sec}$) within 1 min. after power up. After centering you have 1 min. left for another centering. Normally the center input should be left unconnected.

QG series sensors are intended to measure inclination/acceleration/tilt. Flawless function (acc. spec.) is ensured only when used within specifications. This device is not a safety component acc. to EU Machine Directive (ISO13849). For full redundancy two devices can be used. Modifications or non-approved use will result in loss of warranty and void any claims against the manufacturer.

UL & c-UL listed product (File number E312057, UL508 standards UL60947-5-2 & CSA-C22.2 No. 14)
Product Identity / Category Code Number (CCN): Industrial Control Equipment / NRKH & NRKH7
Enclosure rating: type 1, Ambient temperature: max 80°C (see also datasheet, lowest value applies)
Electrical ratings: Intended to be used with a Class 2 power source in accordance with UL1310, max. input Voltage 32V dc (see also datasheet, lowest value applies), max. current 200mA
Accessory Cable Assembly: Any UL-listed (CYJV/7) mating connector with mechanical locking, wire thickness of at least 30 AWG ($0,05\text{ mm}^2$), recommended $\leq 23\text{ AWG}$ ($\geq 0,25\text{ mm}^2$)

As this device is accelerometer-based the sensor is inherent sensitive for accelerations/vibrations. Application specific testing must be carried out to check whether this sensor will fulfil your requirements.