

QG series

QG40N-series SIL CL 1 / PLc

QG40N-KIXv-170-ASP-CM-UL-1c


**Tilt switch for
SIL CL 1 (acc. to IEC 62061)
PLc (acc. to EN ISO 13849)
applications**

1 axis vertical mounting

Programmable device
Output: PNP

Switch points programmable
between $\pm 1^\circ$ and $\pm 170^\circ$

Measuring range
Factory defaults: $\pm 90^\circ$ & $\pm 170^\circ$

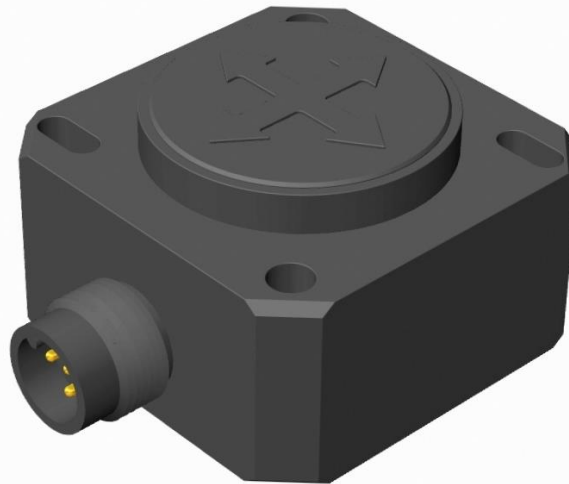

General specifications 12525, v20210611


Housing	Plastic injection molded housing (Arnite T06 202 PBT black)
Dimensions (indicative)	40x40x25 mm (download 3D stepfile from dis-sensors.com)
Mounting	Included: 2x M3x25 mm zinc plated steel pozidrive pan head screws, self-tapping (PZ DIN 7500CZ)
Ingress Protection (IEC 60529)	IP67, IP69K (with IP69K mating connector)
Relative humidity	0 - 95% (non condensing, housing fully potted)
Weight	approx. 45 gram
Supply voltage	5- 32 V dc
Polarity protection	Yes
Current consumption	≤ 20 mA
Operating temperature	-40 .. +60 °C
Storage temperature	-40 .. +85 °C
Measuring range	Factory defaults: $\pm 90^\circ$ & $\pm 170^\circ$
Centering function	Yes (0°), range: 360°
Frequency response (-3dB)	0 - 0,7 Hz
Accuracy (overall @20°C)	0,3° typ.
Offset error	not applicable after zeroing
Non linearity	not applicable
Sensitivity error	not applicable, Repeatability 0,2°
Resolution	0,1°
Temperature coefficient	$\pm 0,02^\circ/\text{K}$ typ.
Max mechanical shock	10.000g
Output	dual PNP
Output load	2x 200 mA continuously, outputs protected against back EMF
Short circuit protection	Yes
Boot time	< 1 s (Non-conducting during boot-up)
Programming options	by optional QG40N-configurator (switch points, delay times, filtering)

QG series

QG40N-KIXv-170-ASP-CM-UL-1c


2 independent PNP outputs:
 - Programmable switchpoints $\pm S$ (optional QG40N Configurator)
 - Operation zone: conducting
 - Critical zone: non-conducting
 - Unpowered sensor: non-conducting
 - Diagnostic error: non-conducting

Factory defaults:
 - Switchpoint $\pm S$ output 1: $\pm 90^\circ$
 - Switchpoint $\pm S$ output 2: $\pm 170^\circ$
 - Hysteresis: $0,5^\circ$
 - operation \blacktriangleright critical delay : 0,5 s
 - critical \blacktriangleright operation delay : 1 s

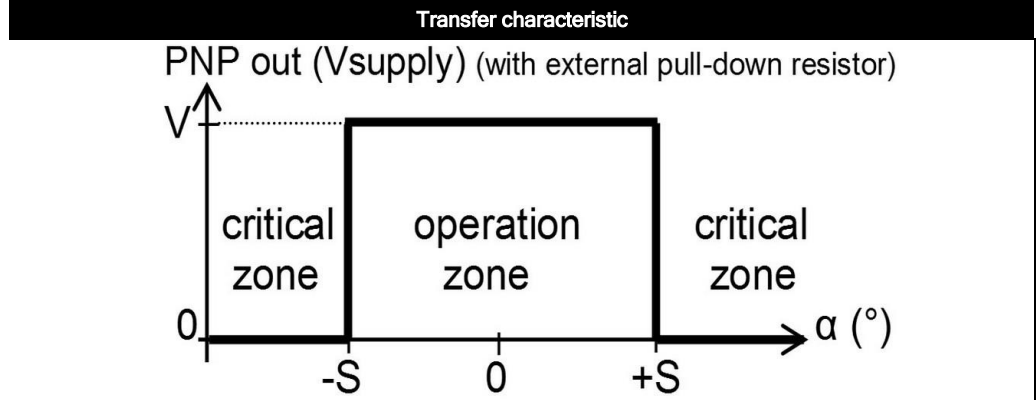

The default 0° position is when the sensor is mounted vertically (M12 downwards) and no acceleration is applied.


Zeroing: eliminate mech. offsets
 Connect zeroing input to ground ($>0,5\text{sec}$) within 1 min. after power up. Normally the zeroing input should be left unconnected.
 Zeroing is possible at any position in vertical plane.

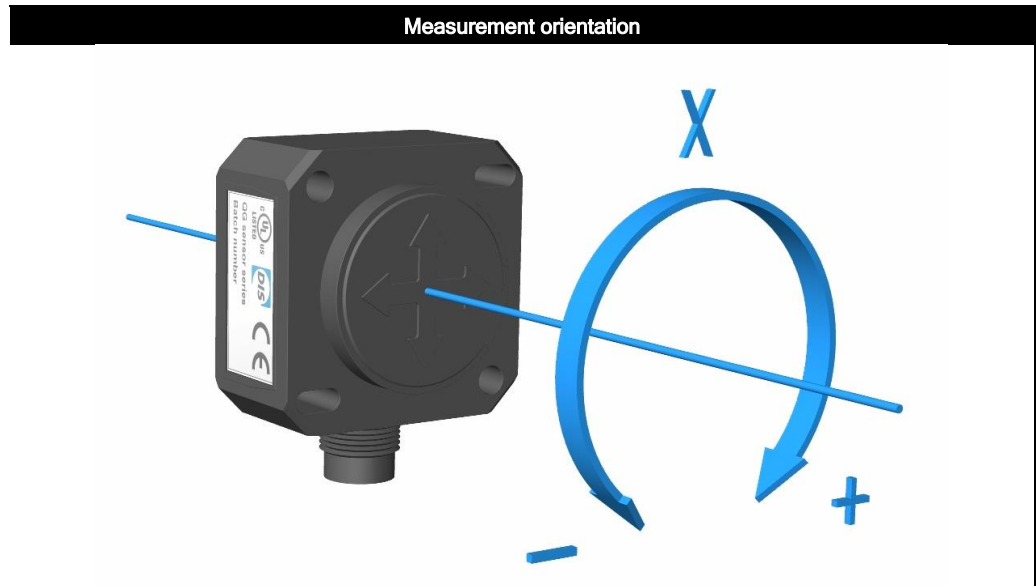

Connection
Wire / pin coding

Connectivity (cable length $\pm 10\%$)	
M12 5p male connector (Glass fibre reinforced grade, contacts CuZn pre-nickeled galv. Au)	
Pin 1:	+ Supply Voltage
Pin 2:	output 2
Pin 3:	Gnd
Pin 4:	output 1
Pin 5:	zeroing
If connected with M12 F (accessory sold by DIS):	
Brown:	+ Supply Voltage
White:	output 2
Blue:	Gnd
Black:	output 1
Green/yellow:	zeroing

Mechanical dimensions (indicative only)

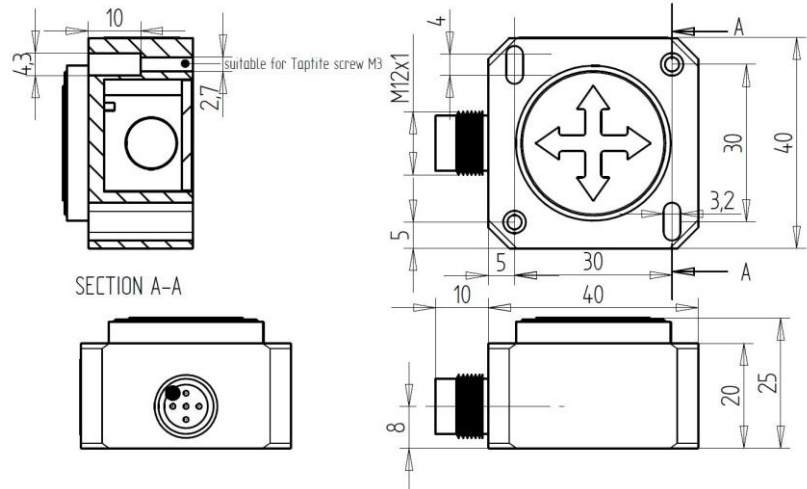

Safety Information, Intended use, UL, Remarks

QG series sensors are intended to measure inclination, acceleration or tilt angle after installing in machines, equipment and systems. Flawless function in accordance with the specifications is ensured only when the device is used within its specifications. Modifications or non-approved use are not permitted and will result in loss of warranty and void any claims against the manufacturer.

Safety information:

- Read this datasheet carefully before using this device in a safety application
- Read the safety manual first (download from dis-sensors.com)
- Read the Declaration of Conformity (download from dis-sensors.com)
- Safety level: SIL CL 1 (acc. to IEC 62061) , PLc (acc. to EN ISO 13849)
- Judgement if this device can be used as safety device in customers application is the solely responsibility of the customer involved. Calculations can be based on these figures:
 - Hardware architecture: HFT=0 (according IEC 62061), CAT.2 (according to EN ISO 13849)
 - MTTFd: 415 years, DC: >60% ("low"), CCF: 65pt, SFF: >60%, PFHD:1,5E-07
 - Error: any diagnostic error will force both sensor outputs to "non-conducting" (low)
 - MCU Unknown interrupt
 - MCU RAM error
 - MCU FLASH error
 - MCU EEPROM error
 - MCU Watch Dog error
 - Sensor Self-test error
 - Sensor Interrupt error
 - Sensor Data format sensor error
 - Measurement error (fault in sensor element)
 - output error (output is not equal to processor output)
 - voltage error
- If the sensor output becomes non-conducting (low) during operation the controller of the application involved should take appropriate action to prevent hazardous situations. This situation can be caused by a real hazardous situation, by a defect in the sensor itself or by an external cause (e.g. in the wiring). Only if the sensor output remains non-conducting (low) after a power cycle and booting up in 'operation zone', the sensor is defective.
- If the device does not meet the safety requirements for an application it can be used redundant.
 - Safety Related Fault Respons Time (SRFRT): <300ms
 - Proof test interval (mission time): 20 years

UL & c-UL listed product (File number E312057, UL508 standards UL60947-5-2 & CSA-C22,2 No. 14)
 Product Identity / Category Code Number (CCN): Industrial Control Equipment / NRKH & NRKH7
 Enclosure rating: type 1, Ambient temperature: max 80 °C (see also datasheet, lowest value applies)
 Electrical ratings: Intended to be used with a Class 2 power source in accordance with UL1310, max. input Voltage 32V dc (see also datasheet, lowest value applies), max. current 200mA
 Accessory Cable Assembly: Any UL-listed (CYJV/7) mating connector with mechanical locking, wire thickness of at least 30 AWG (0,05 mm²), recommended ≤23 AWG (≥0,25 mm²)

As this device is accelerometer-based the sensor is inherent sensitive for accelerations/vibrations. Application specific testing must be carried out to check whether this sensor will fulfil your requirements.